



WATER ISOMETRIC N.T.S. 4

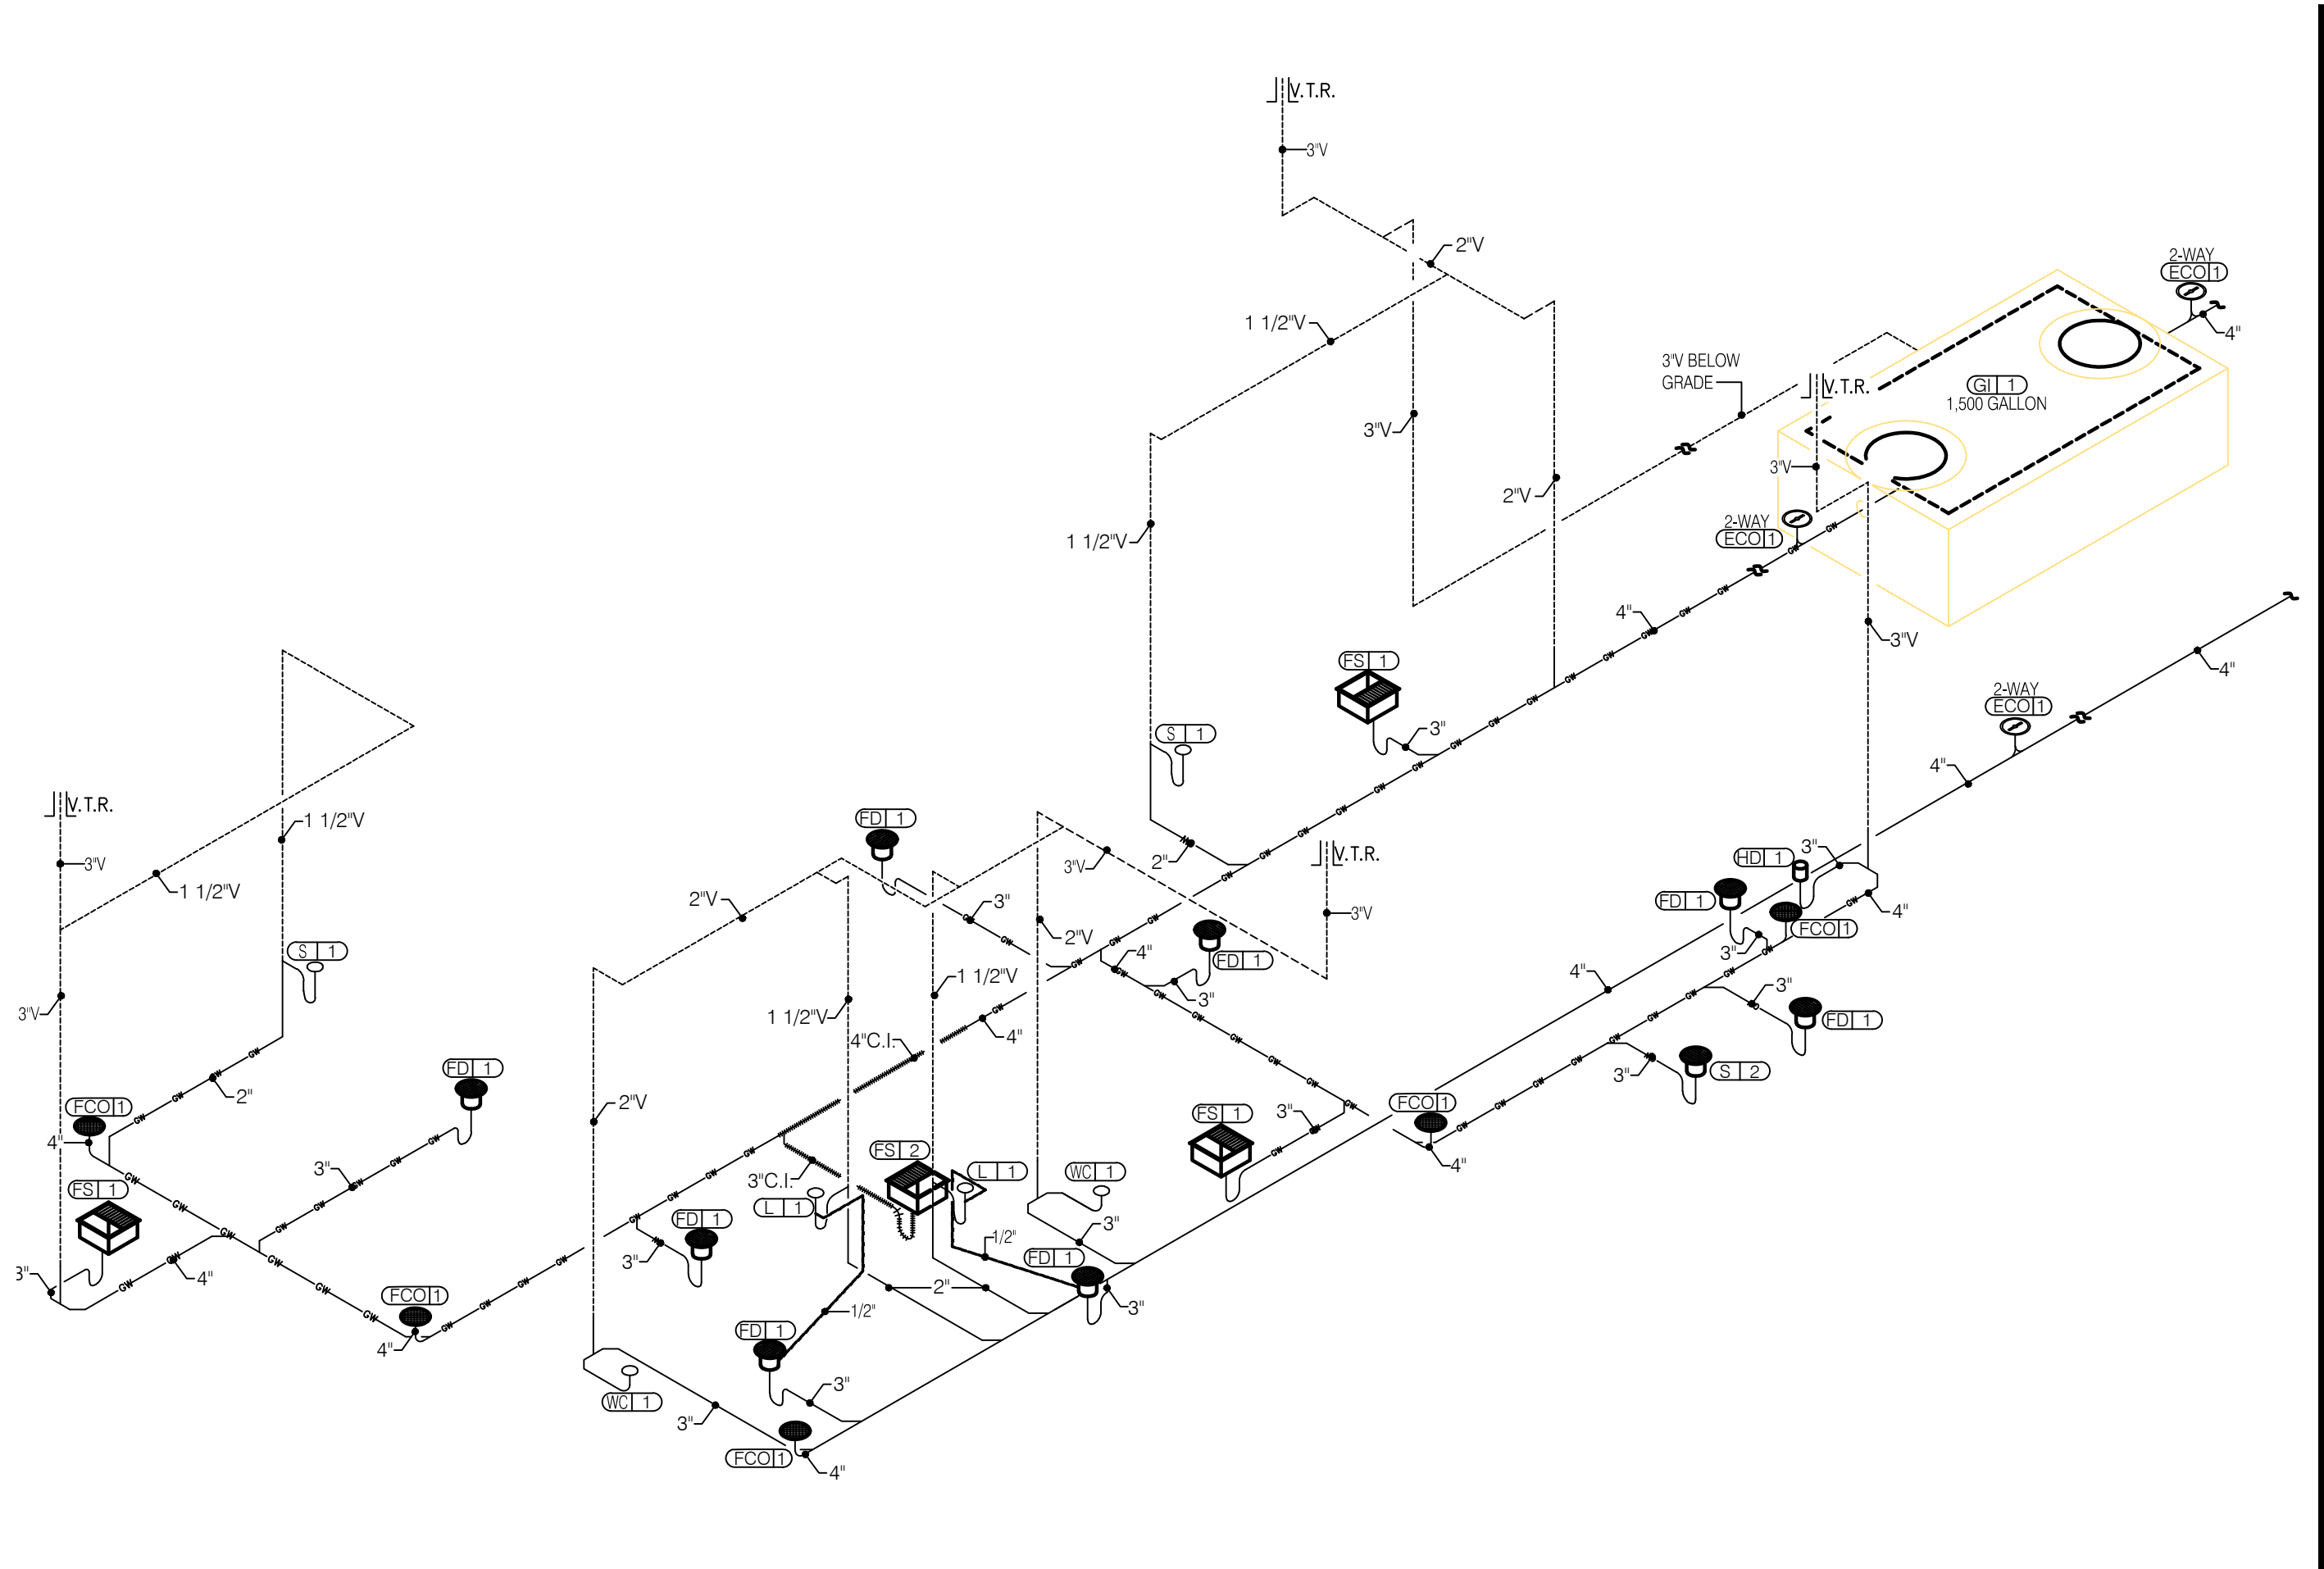


WASTE AND VENT ISOMETRIC N.T.S. 1

GAS DEMAND SCHEDULE	
DEMAND (MBH)	
ITEM	IND. DEMAND
DOUBLE FRYER	160.00
RE THERMALIZER	110.00
SUBTOTAL KITCHEN	270.00
RTU-1	120.00
RTU-2	150.00
SUBTOTAL HEATING	270.00
RINNAI	199.00
RINNAI	199.00
SUBTOTAL WTR. HTR.	398.00
TOTAL DEMAND	938.00
MOST REMOTE FIXTURE DIST. (FT.)	125'
BUILDING GAS MAIN SIZE	2 1/2"



NOTES:  
1. ALL VALVES SHALL BE SAME SIZE AS PIPING SERVED (MIN.).  
2. ALL GAS PIPE SIZES BASED ON NATURAL GAS: 7" W.C., 0.5 PSI (MAX.), 0.6 SPECIFIC GRAVITY, AND 0.5" W.C. PRESSURE DROP. P.C. SHALL VERIFY THAT GAS SYSTEM PRESSURE DOES NOT EXCEED ALLOWABLE LIMITS OF GAS UTILIZATION EQUIPMENT.  
3. SEE SHEET P3 FOR GAS PIPING PLAN.  
4. CONTRACTOR SHALL RUN FULL 2 1/2" DIAMETER PIPE FROM GAS METER. ANY REDUCTION ON SIZE WILL NOT BE ACCEPTABLE.

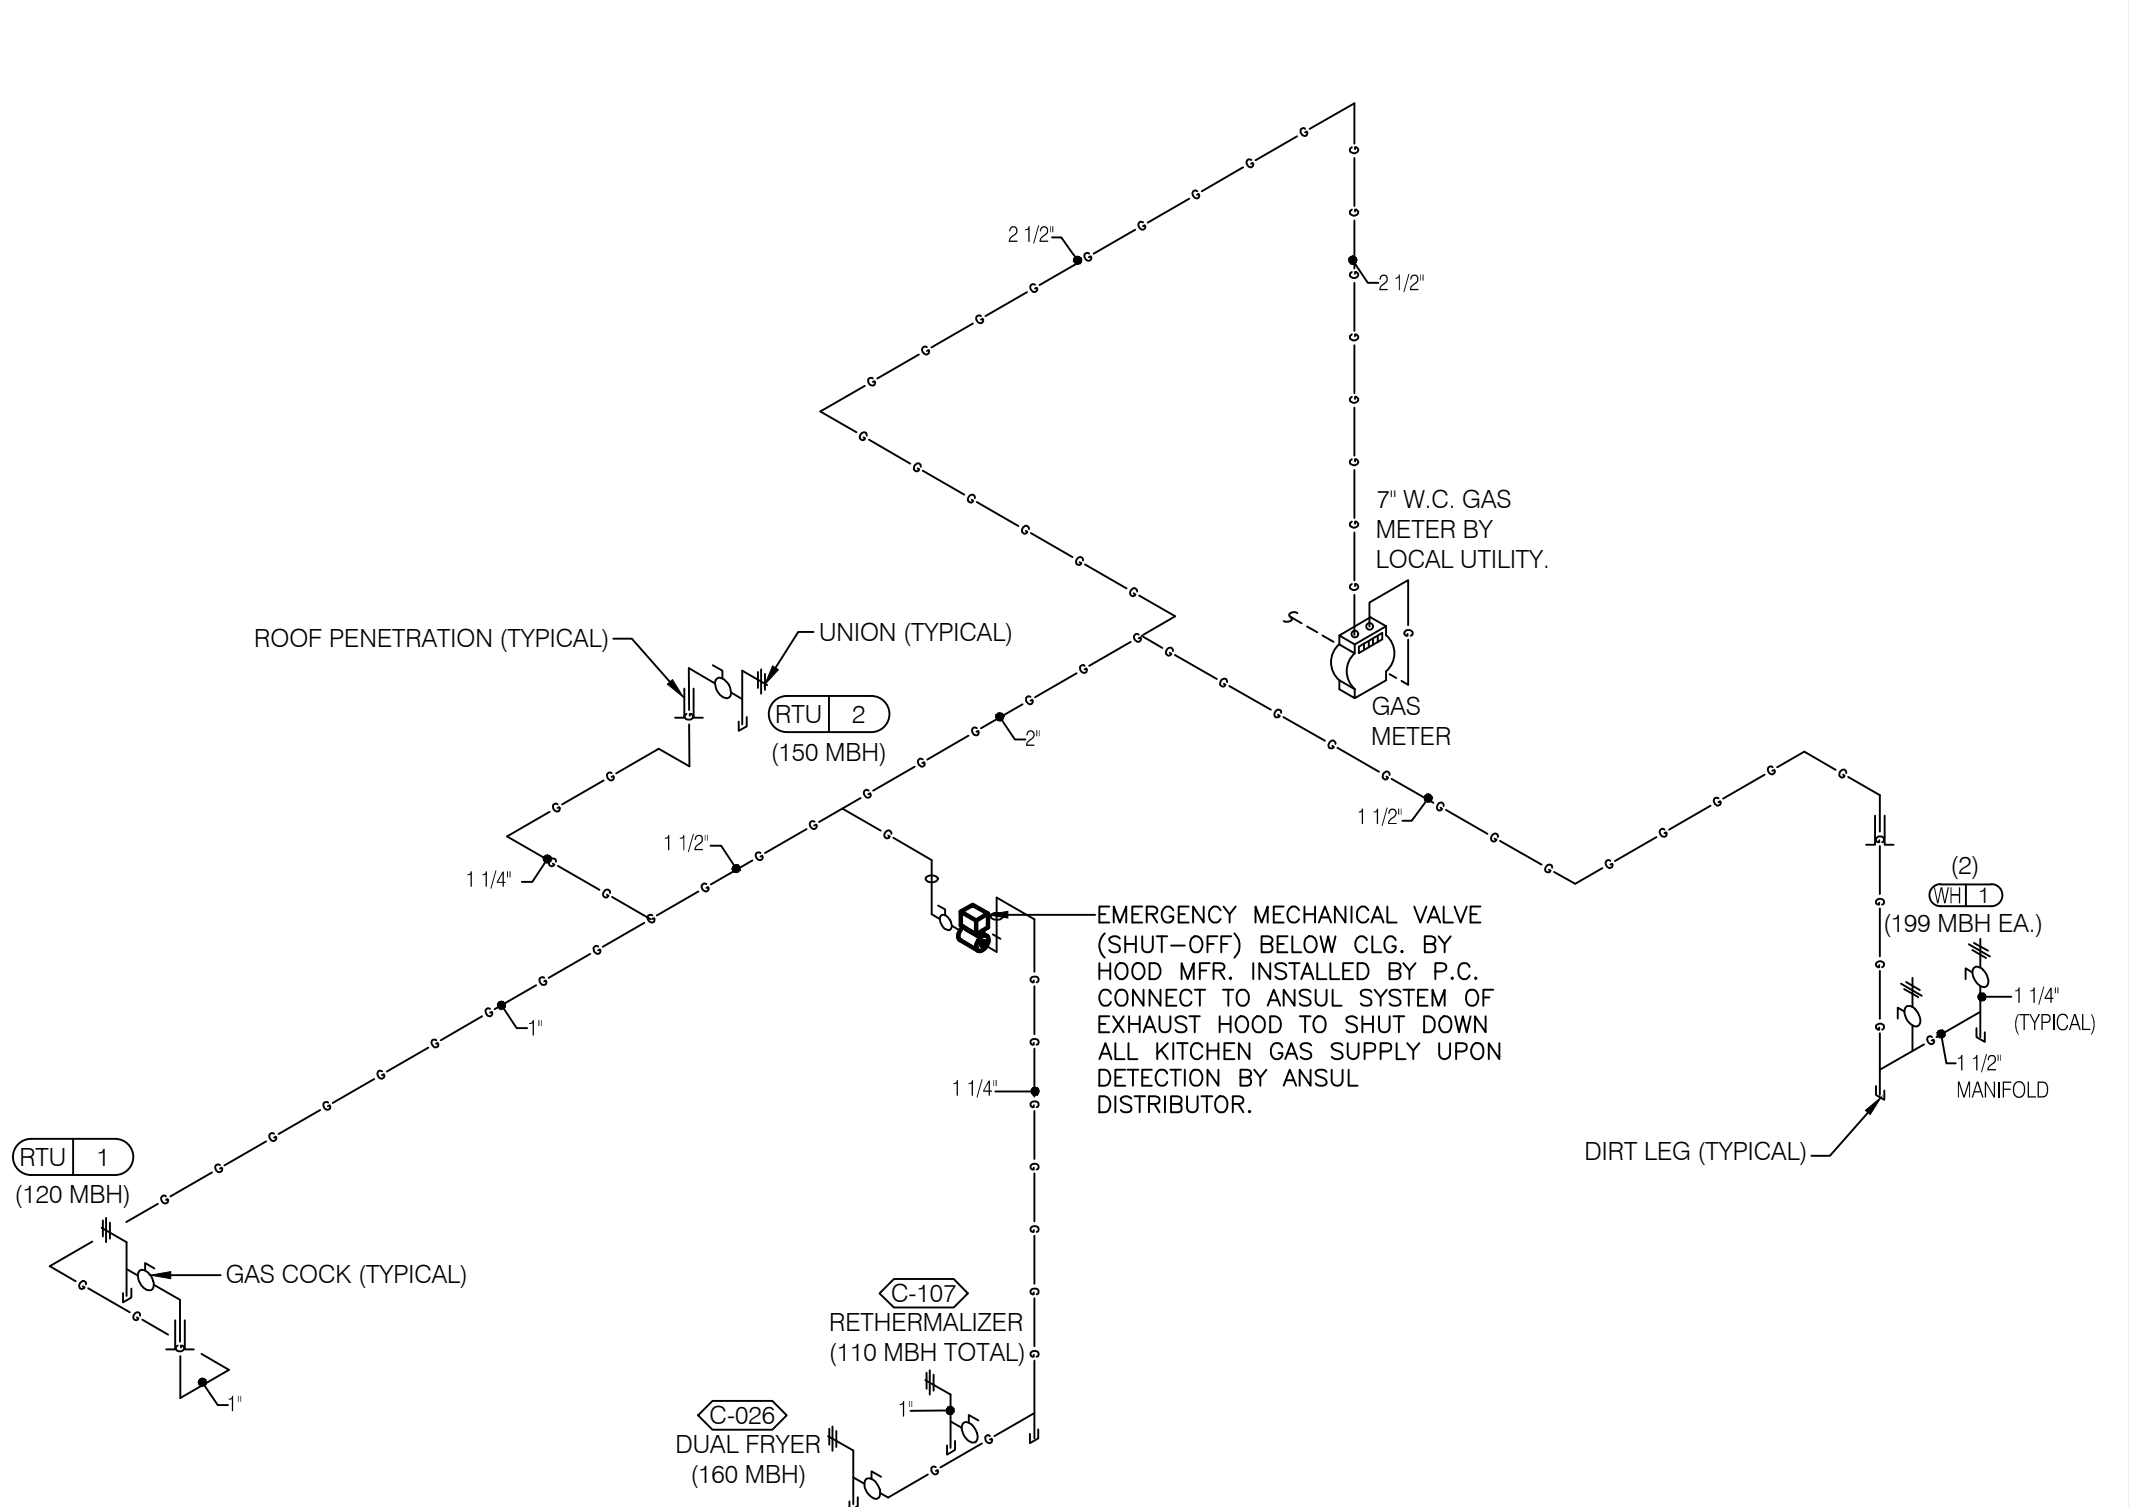

GAS ISOMETRIC N.T.S. 5

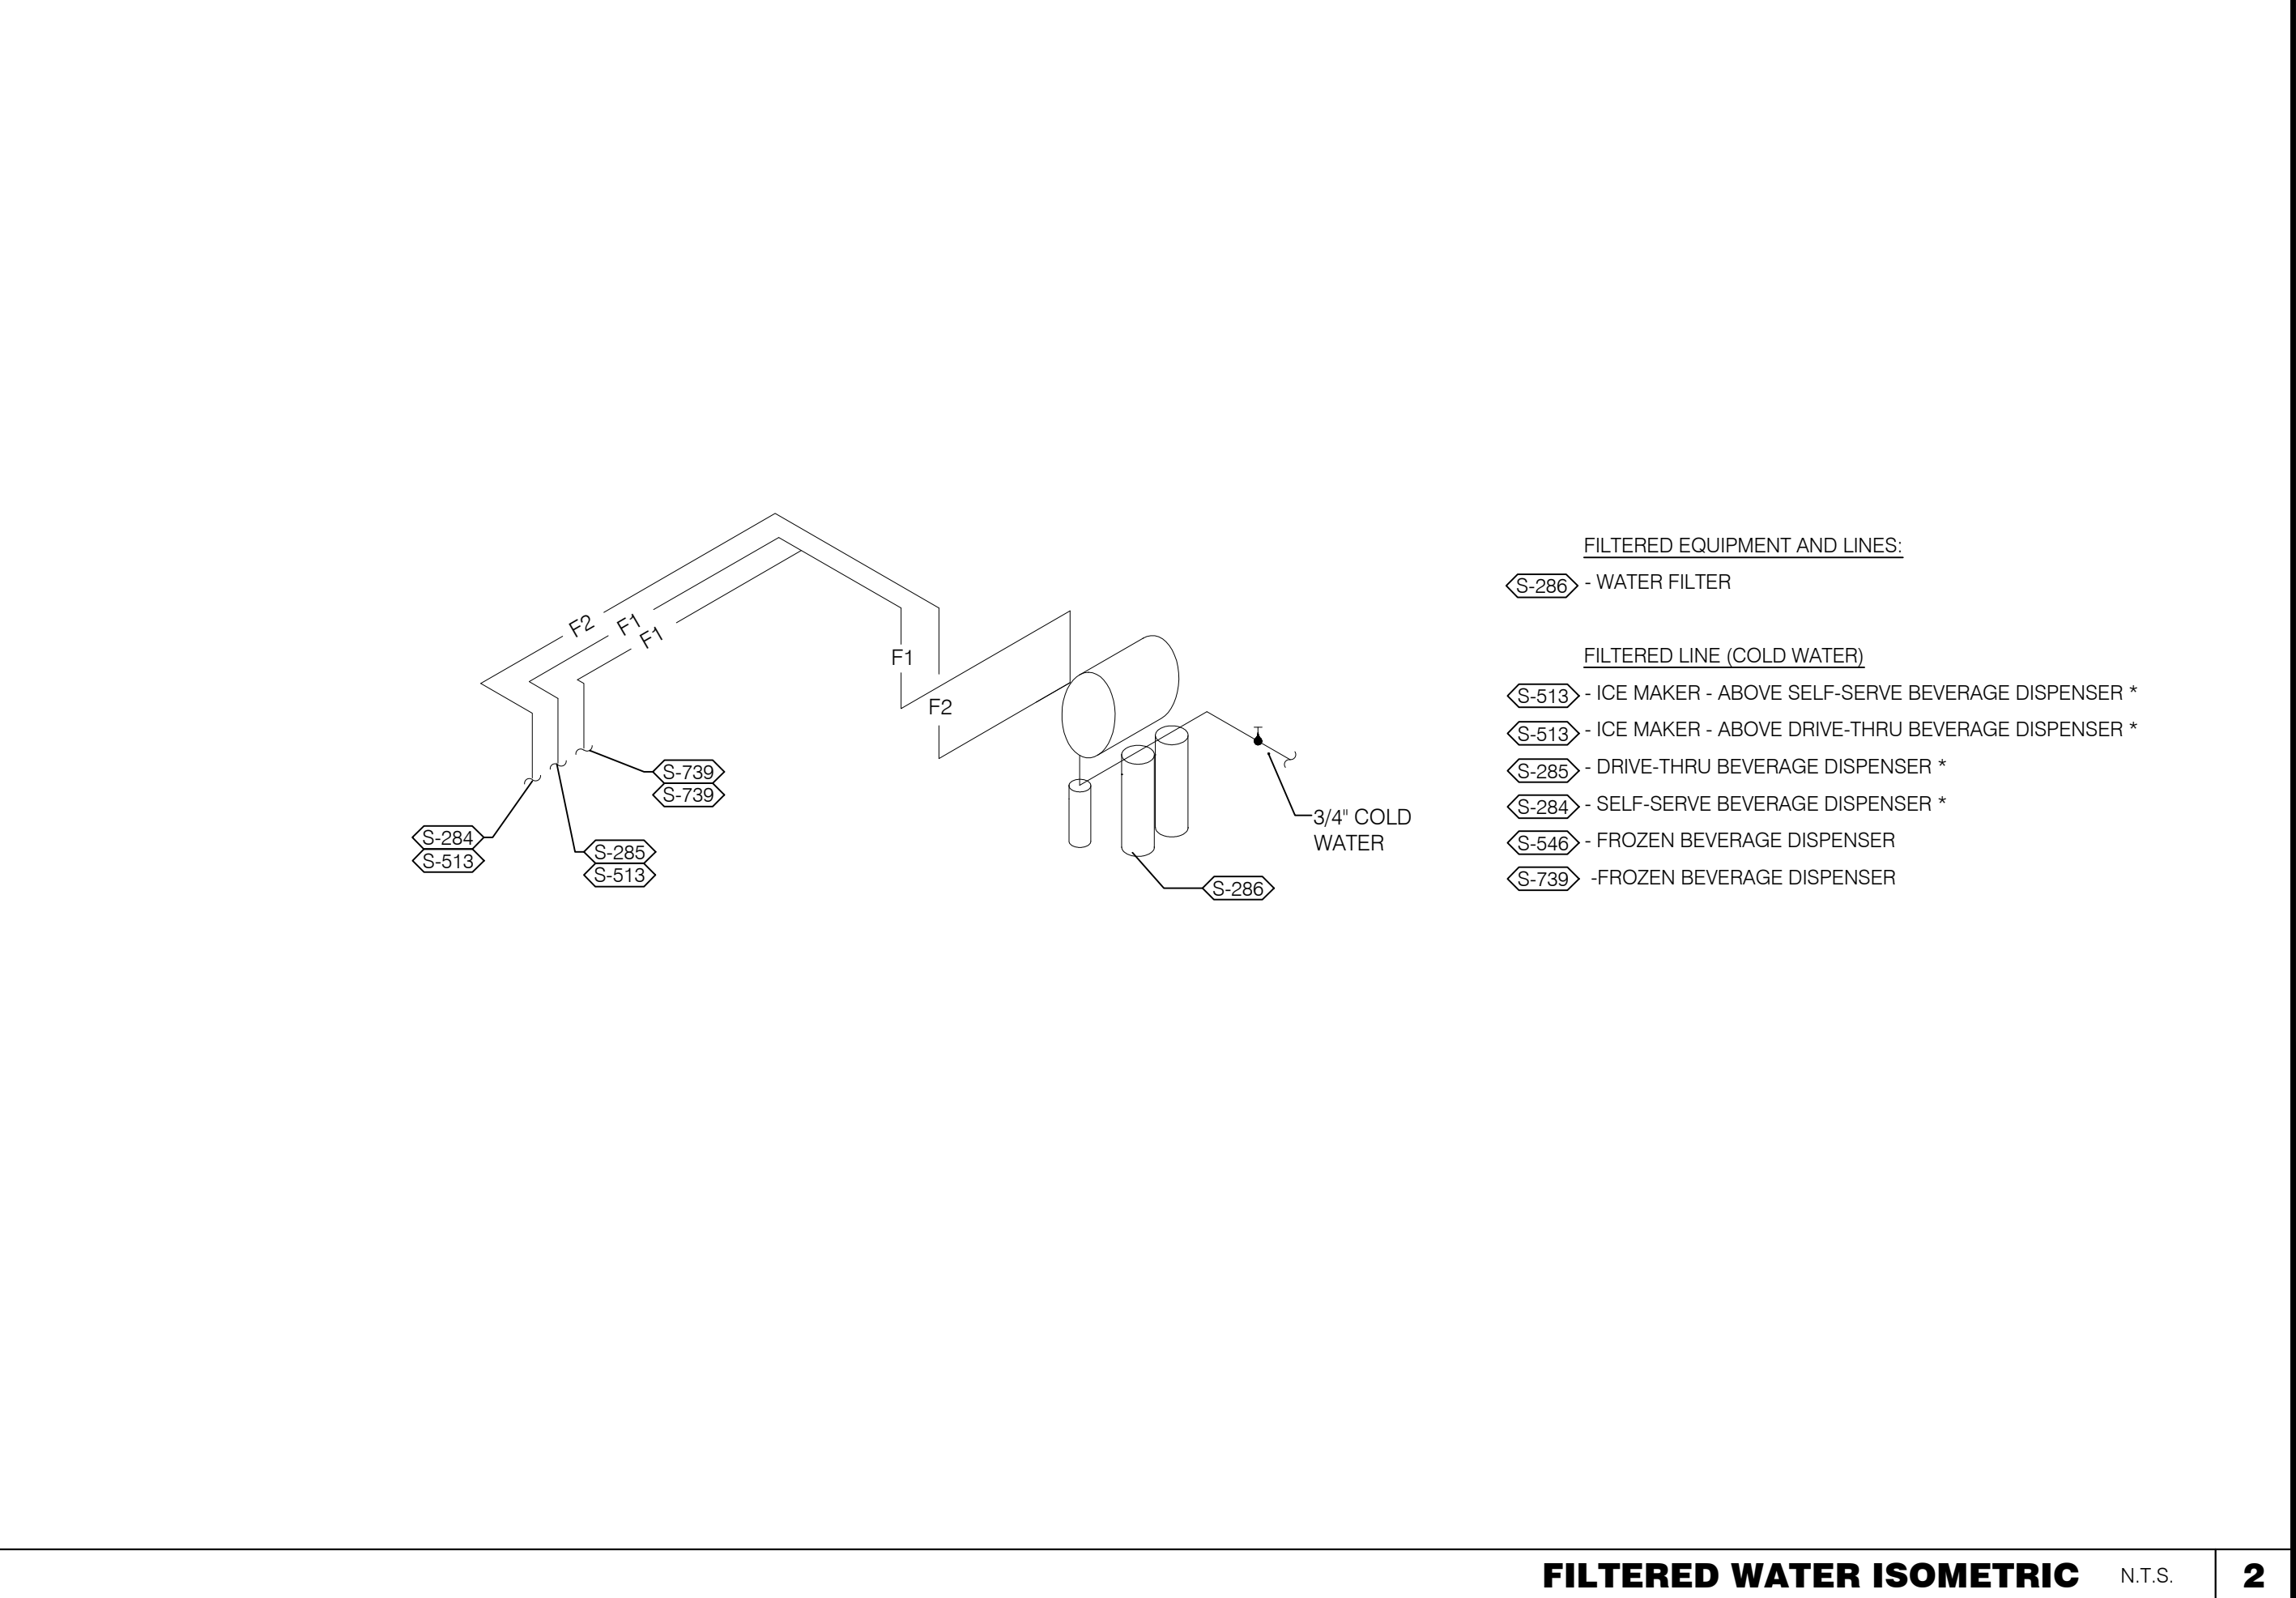

FILTERED WATER ISOMETRIC N.T.S. 2

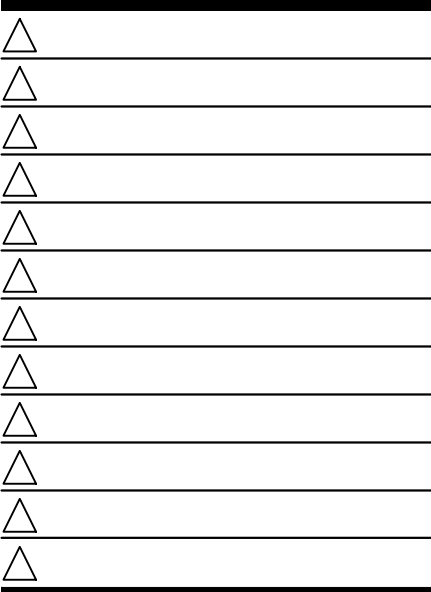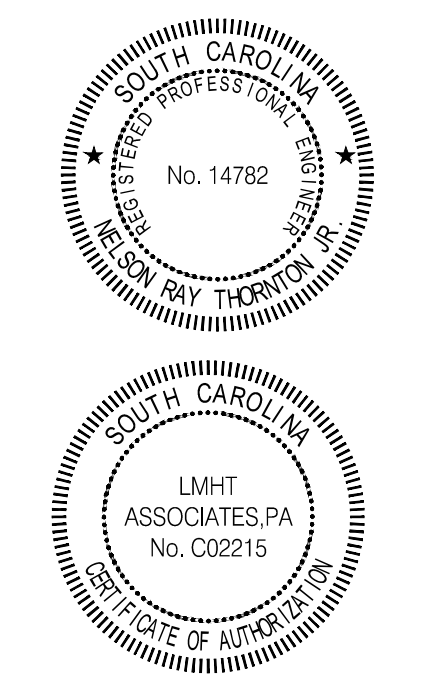

CONTRACT DATE: XXXXX  
BUILDING TYPE: XXXXX  
PLAN VERSION: XXXXX  
SITE NUMBER: 315669  
STORE NUMBER: XXXXX

TACO BELL  
SPEARS CREEK CHURCH RD.  
ELGIN, SC 29045



ENDEAVOR 2.0  
PLUMBING  
RISER  
DIAGRAMS

P5.0